



**Public Works Department
Engineering Division**

1 CITY HALL SQUARE, ROOM 710
BOSTON, MA 02201
1630
(617) 635-4968


PAVEMENT SECTION - SCORED CEMENT CONCRETE

DATE OF ISSUE:
SEPTEMBER 2018

SCALE: N.T.S.

DETAIL NO.


P.3

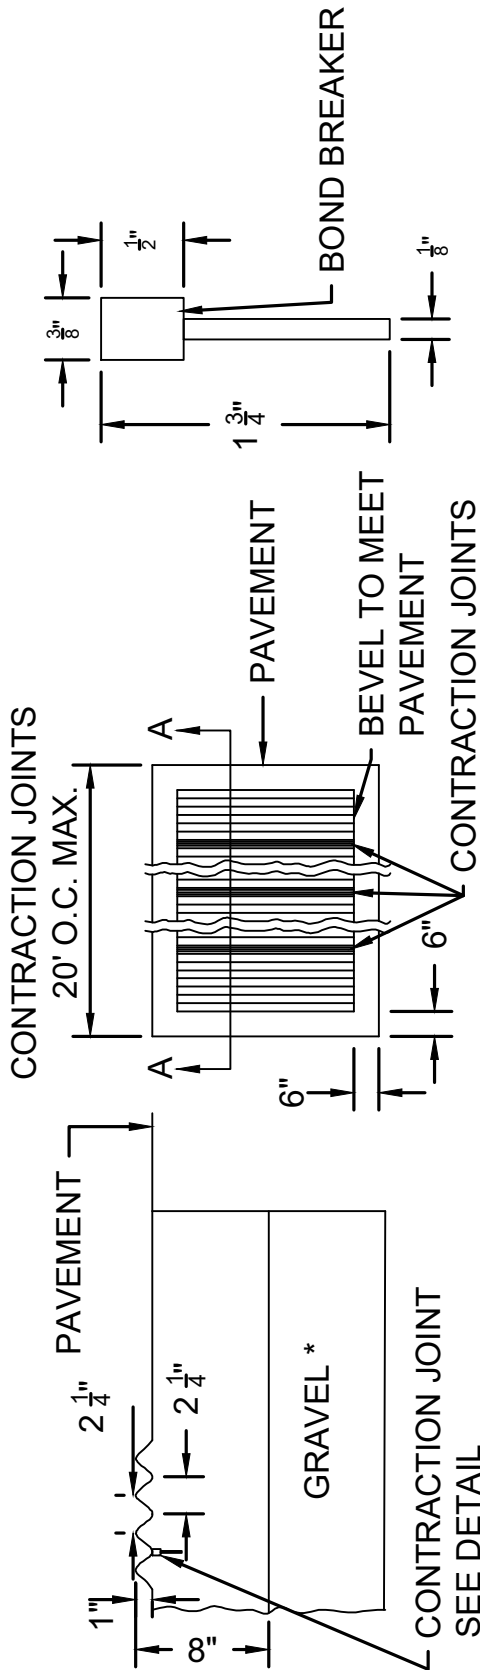

DETAIL OF CORRUGATIONS

PLAN VIEW

CONTRACTION JOINT DETAIL

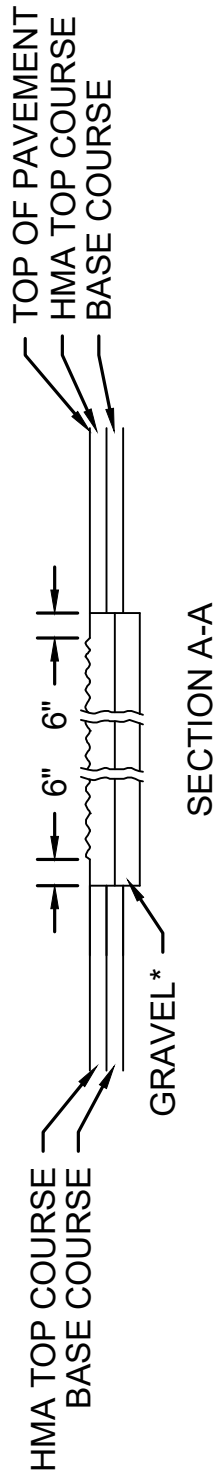

SECTION A-A

*THE DEPTH OF THE GRAVEL IS TO BE SUCH THAT ITS BOTTOM LINE MEETS THE BOTTOM OF THE GRAVEL LINE OF THE CONTIGUOUS PAVEMENT.

NOTES:

1. CONTRACTION JOINTS ARE TO BE SPACED AT A MAXIMUM OF 20' APART.
2. THE JOINTS ARE TO BE SAWED AND LOCATED IN THE DEPRESSIONS OF THE CORRUGATIONS. SEE CORRUIGATION DETAIL.
3. END OF CORRUGATED RIDGES TO BE BEVELED.
4. SCORED CEMENT CONCRETE TO BE: 5000 PSI - 3/4" - 705 LB/CY.
6. TROUGH FLUSH WITH OR ABOVE ADJACENT PAVEMENT FOR DRAINAGE.